

Addendum 02

DOCUMENT 00 91 00

DATE: February 20, 2026

PROJECT: Van Wert Eggerss Stadium Renovation Phase Four
205 West Crawford Street
Van Wert, Ohio 45891

PROJECT #: 25089.00

OWNER: Van Wert City Schools
Contact: Mark Bagley
205 West Crawford Street
Van Wert, Ohio 45891

ARCHITECT: Garmann Miller
38 South Lincoln Drive
P.O. Box 71
Minster, Ohio 45865

TO: Prospective Bidders

This addendum form is a part of the Contract Documents and modifies the Construction Documents dated January 29, 2026 with amendments and additions noted below.

Acknowledge receipt of this Addendum on the Bid Form. Failure to do so may disqualify the Bidder.

This addendum consists of 2 pages and 5 re-issued drawing sheets.

FOR INFORMATION ONLY

1. The sanitary and waterline shown under the existing bleacher/pressbox is NOT included in the scope of work on this phase. That work was completed in a previous phase.
2. The cores of the exterior split face CMU no longer need to be insulated.

CHANGES TO THE PROJECT MANUAL

1. Section 03 30 00 Cast-In-Place Concrete: Add Mapefibre as an acceptable manufacturer for fiber reinforcing.
2. Section 32 31 15 – Add Ultra Aluminum Fence as an acceptable manufacturer.



CHANGES TO THE DRAWINGS

3. Sheet C3.2 – Pavement Elevations Plan
 - a. Added spot elevations to each masonry column for further clarification.
4. Sheet L1.1 – Site Layout and Materials Plan
 - a. Area around existing transformer to be fine grade and seeded, per specifications. Install gravel mow strip under fence.
 - b. Added elevation detail for clarification on fence/column design and how it relates to the grading plan. Submittal of fence will need to include a drawing indicating the stepped design.
5. Sheet A1.1 – Floor Plan: Add sanitary napkin disposals to restroom stalls in women's restroom.
6. Sheet E1.1 – General Notes, Abbreviations, Legends, and Sheet Index
 - a. Added Service Grounding Electrode System Detail
7. Sheet E8.1 – One-Line Drawing, Panel and Luminaire Schedules
 - a. Added verbiage for keynote 2.
 - b. Add a ground rod to panel D.
 - c. Added equals to the luminaire schedule.
 - d. Modified Fixture 'F1' to have a dark bronze finish.
 - e. Modified Fixture 'S1' to have a dark bronze finish.

ATTACHMENTS

The following attachments are included and are part of this addendum:

Drawing Sheets: C3.2, L1.1, A1.1, E1.1, and E8.1

END OF ADDENDUM



LEGEND

- EP = EXISTING PAVEMENT ELEVATION
- EW = EXISTING SIDEWALK ELEVATION
- P = PROPOSED PAVEMENT ELEVATION
- B = PROPOSED TOP OF CURB ELEVATION
- W = PROPOSED SIDEWALK ELEVATION
- G = PROPOSED GROUND ELEVATION
- TOP = PROPOSED TOP OF GRATE ELEVATION
- B-XXX.XX* = ASTERISK INDICATES PROPOSED TOP OF CURB SPOT GRADE ELEVATION WITH CURB EXPOSURE THAT VARIES FROM THE STANDARD 0.50' (6") CURB

NOTE THAT IN ORDER TO FACILITATE PROPER ADA ACCESS THERE MAY BE AREAS WHERE IT IS INTENDED FOR THERE TO BE NO CURB EXPOSURE (PAVEMENT AND TOP OF CURB TO BE FLUSH). SEE SPOT ELEVATIONS ON THIS SHEET TO DETERMINE WHERE THESE AREAS ARE.

NOTE:
CONTRACTOR TO TIE INTO EXISTING PAVEMENT ELEVATIONS AS REQUIRED WHEREVER NEW PAVEMENT ABUTS UP TO EXISTING PAVEMENT TO ENSURE A SMOOTH TRANSITION. ALL EX. PAVEMENT ELEVATIONS GIVEN ARE APPROXIMATED AND SHALL BE FIELD VERIFIED. CONTRACTOR SHALL ALSO ENSURE THAT A SMOOTH TRANSITION IS PROVIDED WHEREVER PROPOSED GRADES MEET EXISTING GRADES THROUGHOUT THE SITE.


ADA RAMP NOTE:
CONTRACTOR TO SEE ARCHITECTURAL SHEETS FOR ADA RAMP LOCATIONS AND DETAILS. CONTRACTOR SHALL INSTALL ALL ADA RAMP PER ALL ADA REGULATIONS. CONTRACTOR SHALL VERIFY THE FOLLOWING WITH THE CONSTRUCTION MANAGER AND/OR ARCHITECT AND/OR OWNER:

1. THE EXACT LOCATION, CONFIGURATION AND TYPE OF ALL PROPOSED ADA RAMP.
2. ALL AREAS WITHIN THE PROPOSED ADA RAMP WHERE THE CURBING IS TO BE FLUSH WITH PAVEMENT OR WALK TO PROVIDE PROPER ADA ACCESS.
3. THE AREAS WITHIN THE PROPOSED ADA CURB RAMP WHERE FLARES AND RAMP ARE TO BE INSTALLED WITH ADA COMPLIANT SLOPES TO PROVIDE PROPER ADA ACCESS.

PHASE 1 - PROP. TURF FIELD AREA, TURF FIELD DRAINAGE SYSTEM AND GRADING BY TURF INSTALLER. COORDINATE ALL TURF FIELD WORK, DRAINAGE AND GRADING WITH TURF INSTALLER. ALL WORK TO BE AS DIRECTED BY OWNER'S REPRESENTATIVE.

INV. PROP. 12" 769.50

PHASE 1 - INV. PROP. 12" 769.14 CORE AND GROUT

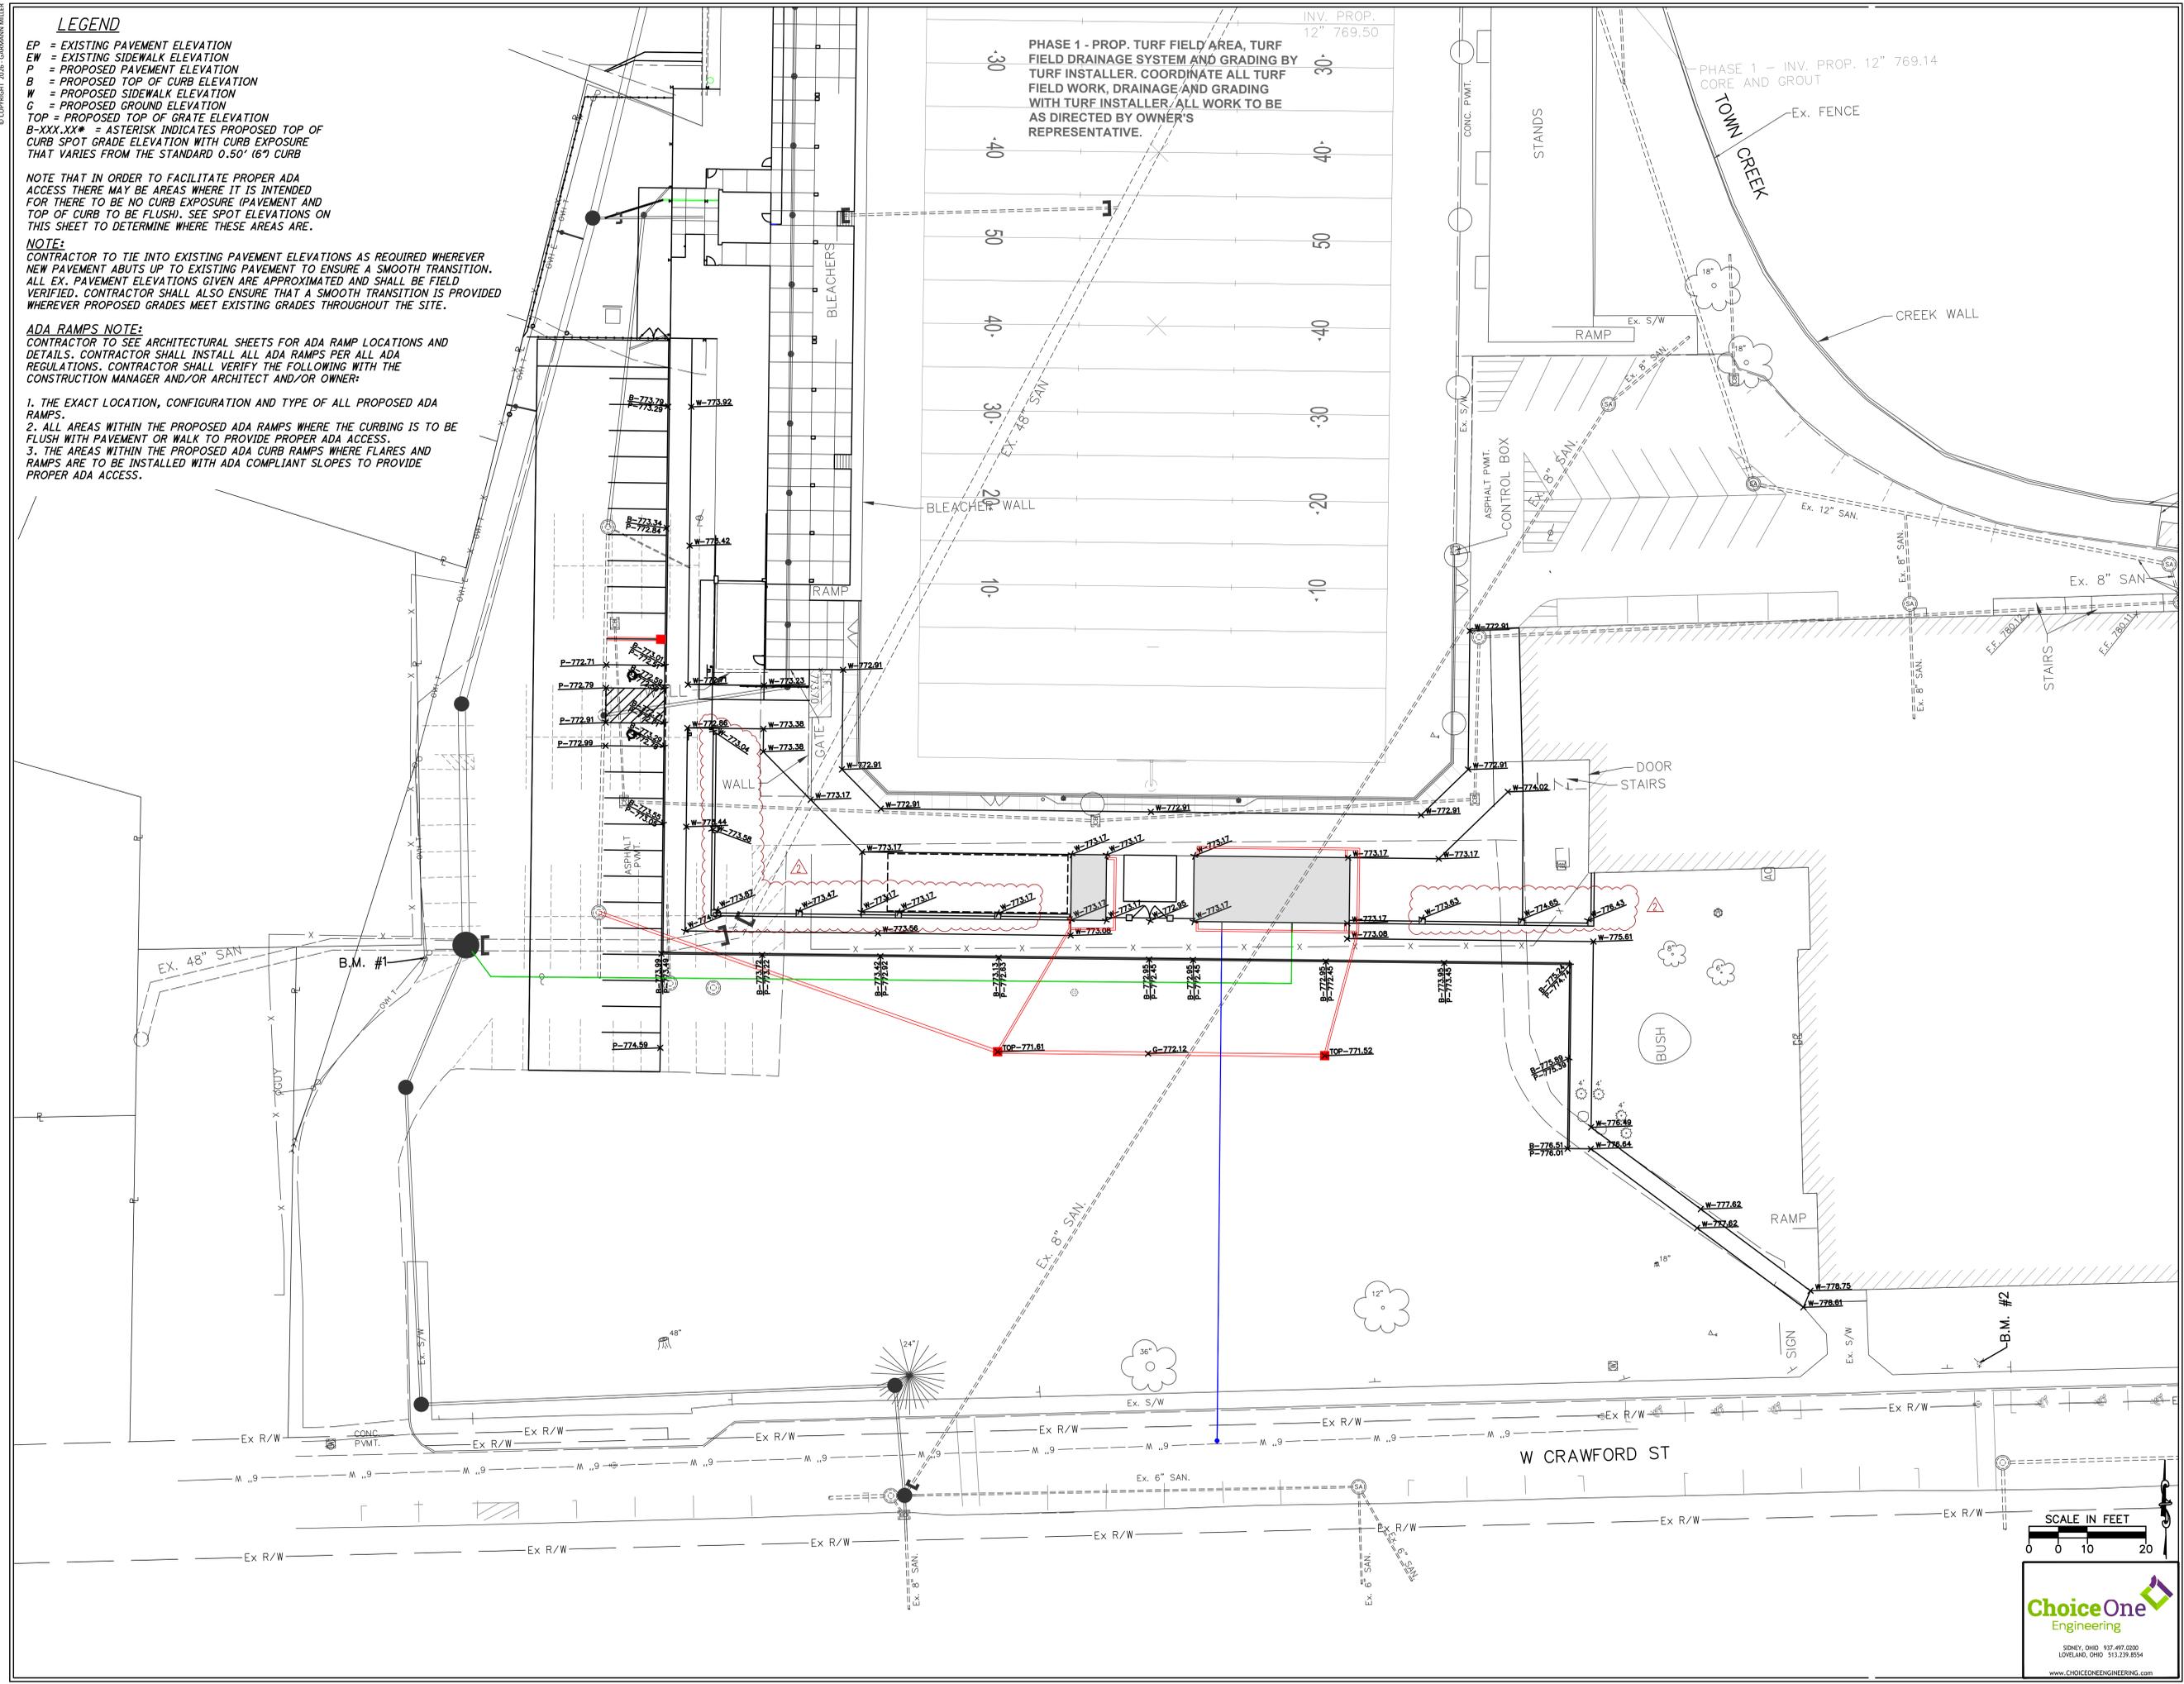

**VAN WERT CITY SCHOOLS
EGGERS STADIUM - PHASE FOUR**

ISSUANCES/REVISIONS	
2	ADDENDUM 02


PROJECT NUMBER:	DRAWN BY:	CHECKED BY:
25089.00	JAC	NIS

SHEET TITLE:
PAVEMENT ELEVATIONS PLAN


SHEET NUMBER:
C3.2

SCALE IN FEET
0 10 20

ChoiceOne Engineering
SUNNY, OHIO 43074-0200
LOVELAND, OHIO 43132-8514
www.CHOICEONEENGINEERING.com

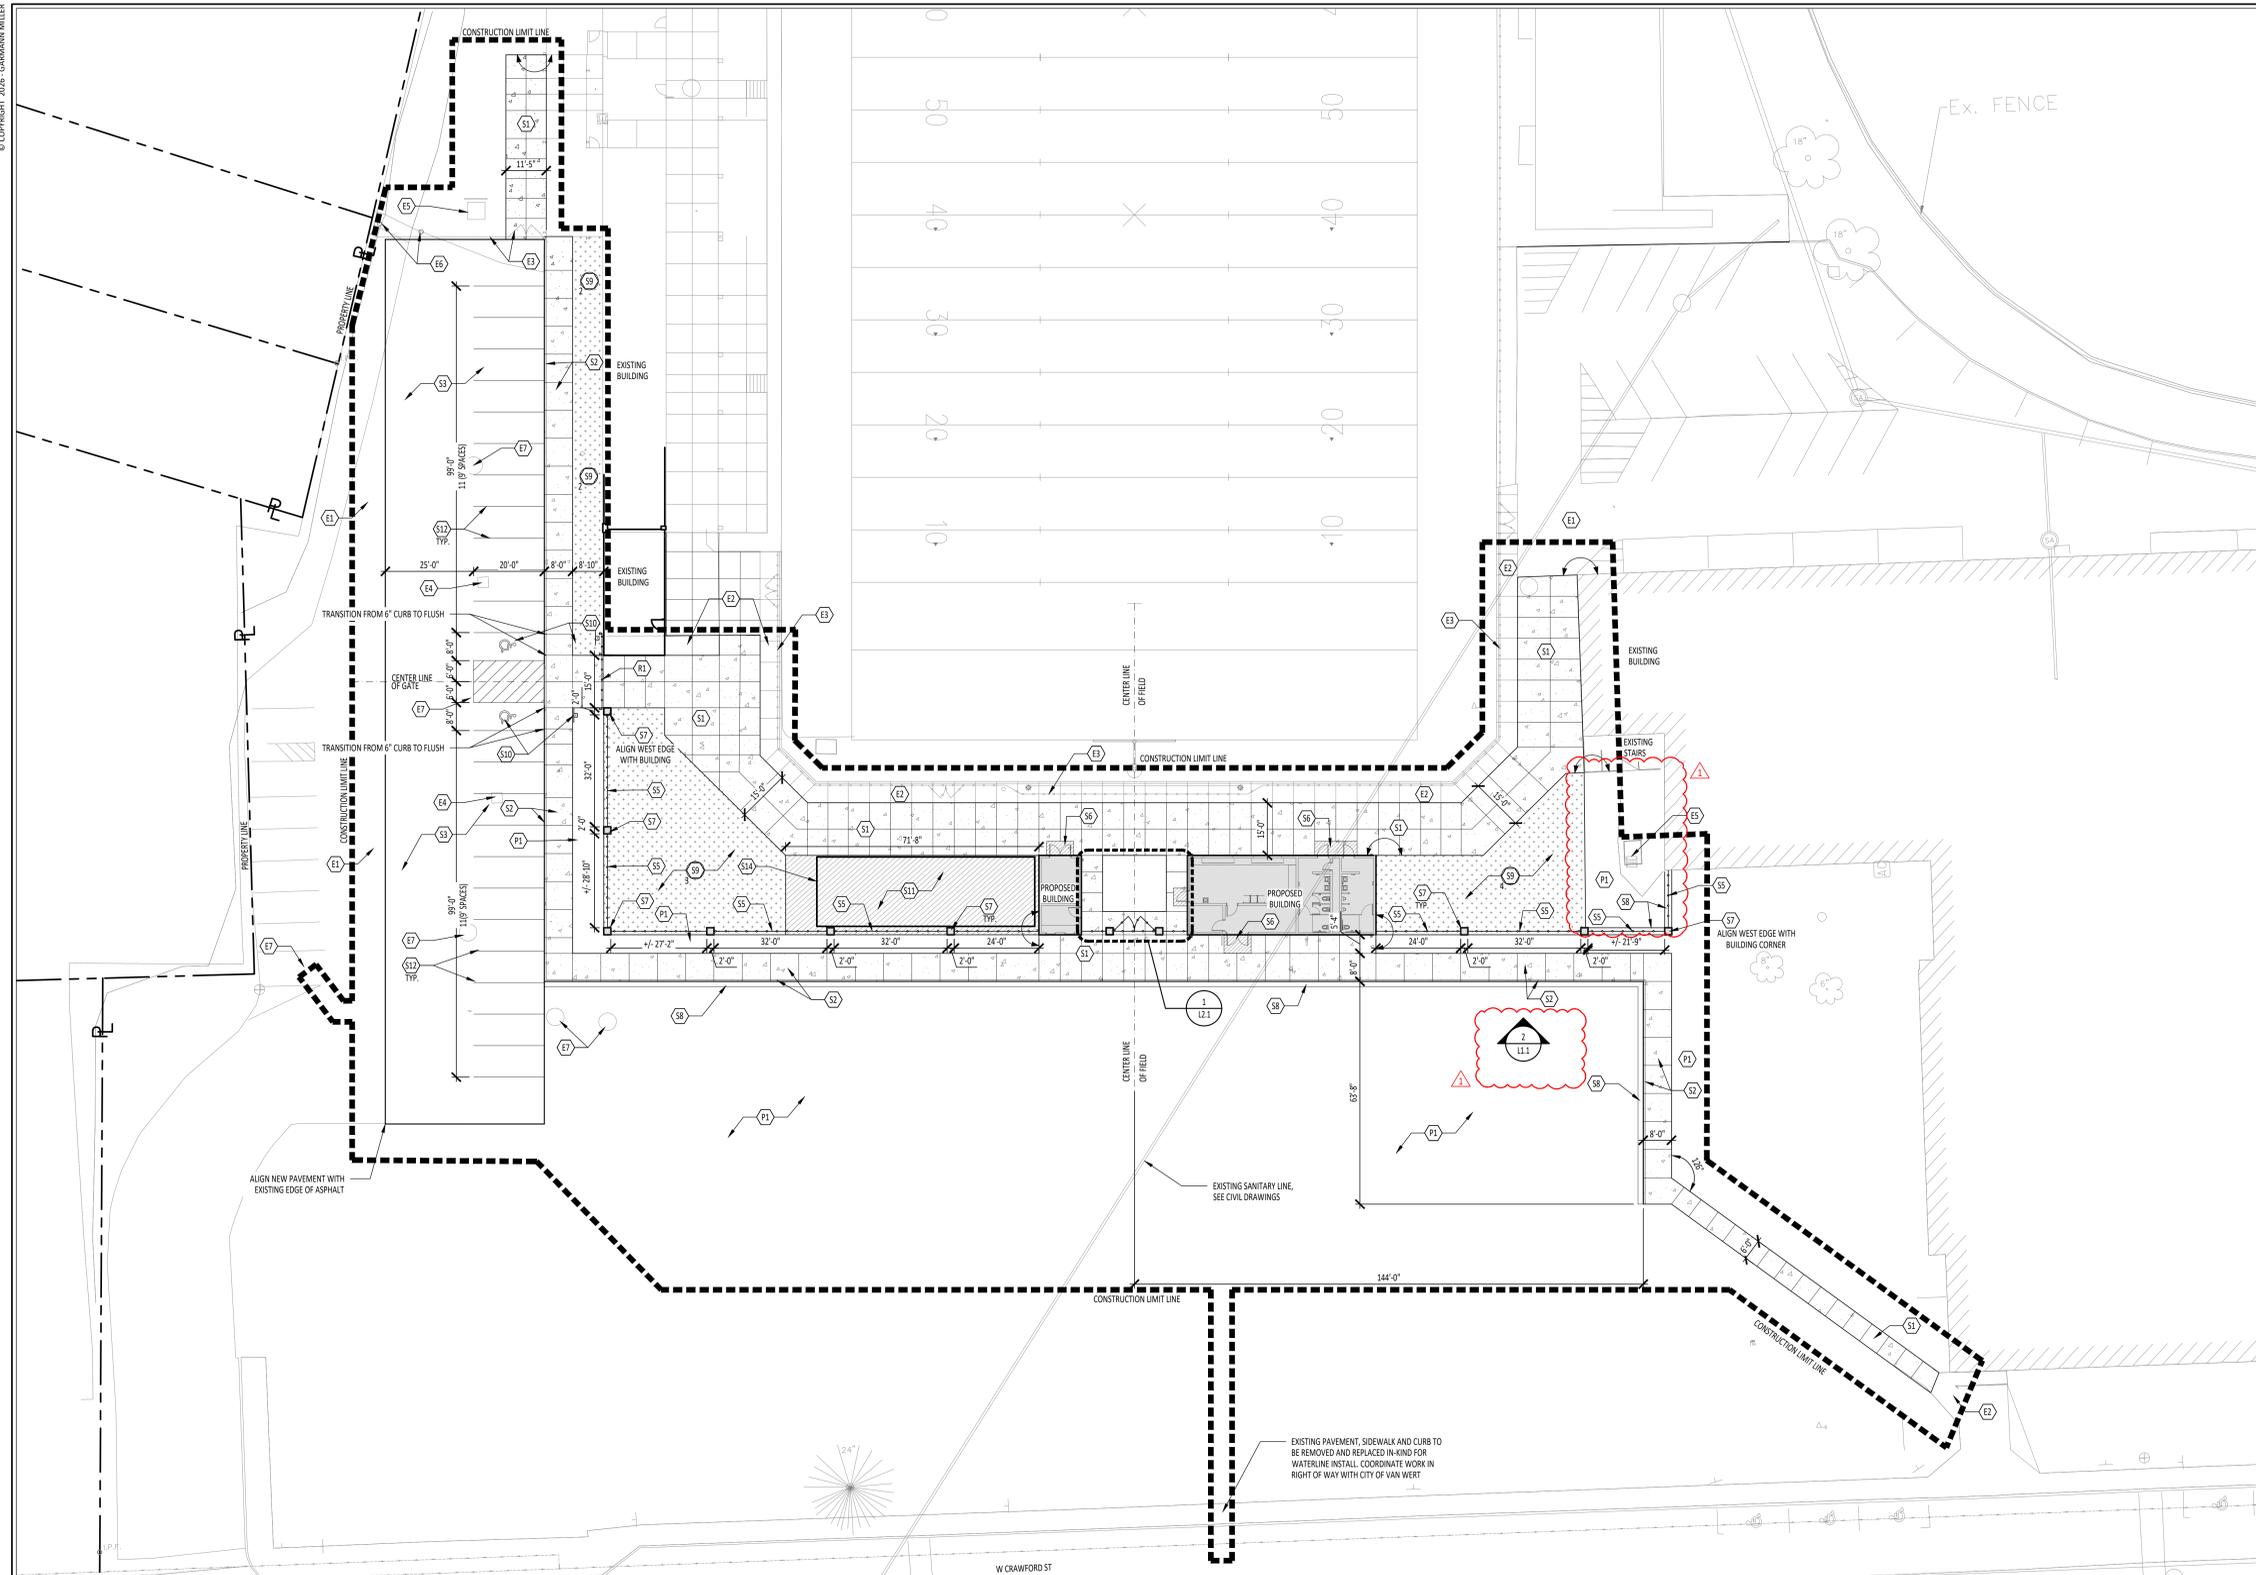

1 SITE LAYOUT AND MATERIALS PLAN
1" = 20'-0"

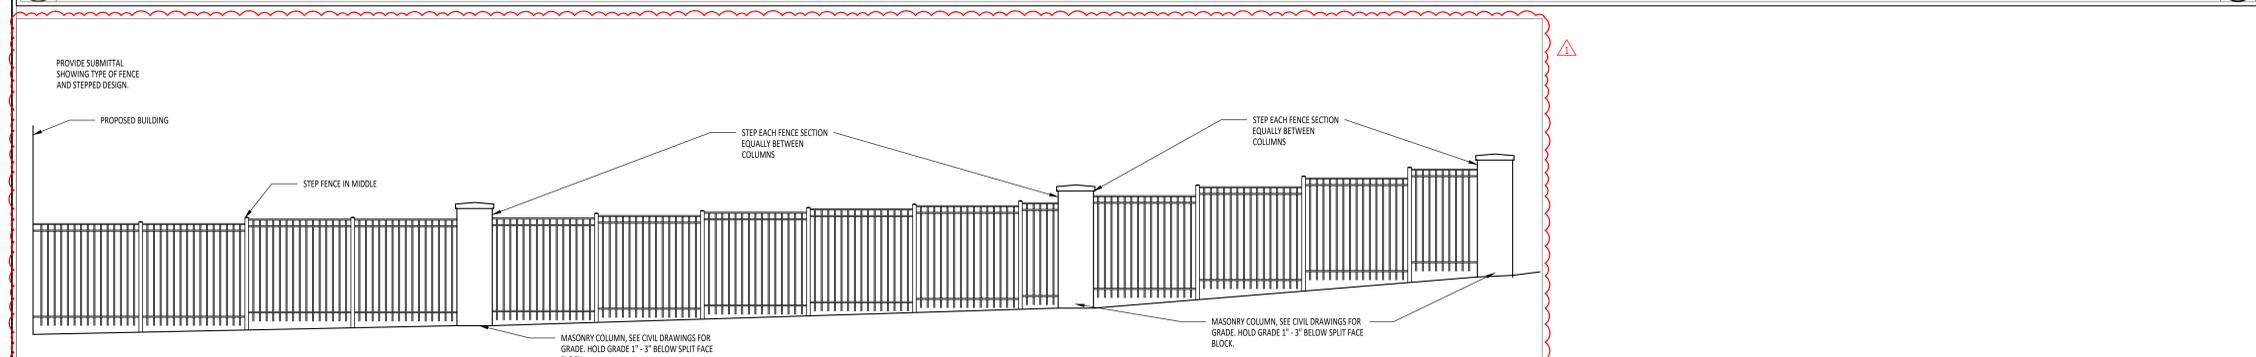


2 FRONT ELEVATION
1/4" = 1'-0"

KEYNOTE SCHEDULE	
EXISTING	
E1	EXISTING ASPHALT TO REMAIN
E2	EXISTING CONCRETE TO REMAIN
E3	EXISTING FENCE TO REMAIN
E4	EXISTING CATCH BASIN TO REMAIN, ADJUST TO GRADE, SEE CIVIL DRAWINGS
E5	EXISTING TRANSFORMER TO REMAIN
E6	EXISTING UTILITY POLE TO REMAIN
E7	EXISTING SANITARY MANHOLE TO REMAIN
PLANTING	
P1	FINE GRADE AND SEED LAWN, SEE SPECIFICATIONS
SITE	
S1	CONCRETE PAVEMENT, SEE DETAIL 4/L2.1
S2	CONCRETE SIDEWALK WITH INTEGRAL CURB, SEE DETAIL 5/L2.1
S3	STANDARD DUTY ASPHALT, SEE DETAIL 6/L2.1
S4	PAVERS OVER CONCRETE BASE, ENGRAVINGS AND PAVERS PROVIDED BY OWNER, SEE DETAIL 8/L2.1 FOR INSTALL
S5	6" HIGH ALUMINUM PICKET FENCE, SEE DETAIL 3/L2.1
S6	CONCRETE ANTI-HEAVE SLAB, COORDINATE WITH STRUCTURAL DRAWINGS
S7	7" HIGH MASONRY COLUMN, SEE DETAIL 3/L2.1
S8	#57 GRAVEL OVER WEED FABRIC, SEE SPECIFICATIONS
S9	BASE BID: #57 GRAVEL OVER WEED FABRIC, SEE SPECIFICATIONS ALTERNATE: CONCRETE PAVEMENT, SEE DETAIL 4/L2.1
S10	ACCESSIBLE PARKING SPACE WITH SIGNAGE, SEE DETAILS 9 & 10/L2.1
S11	CONCRETE PAVEMENT FOR BLEACHER, SEE DETAIL 7/L2.1
S12	PAVEMENT ARROWS, PAVEMENT MARKINGS AND PAINTED ISLANDS
S13	GATEWAY, SEE DETAIL 2/L2.1
S14	ANGLE FRAME ELEVATED BLEACHER, 200 SEAT, SEE SPECIFICATIONS
SALVAGE/RELOCATE	
R1	RELOCATE EXISTING CANTILEVER GATE

LEGEND	
	CONCRETE PAVEMENT
	CONCRETE PAVEMENT - BLEACHER PAD
	GRAVEL PAVEMENT
	BASE BID: GRAVEL OVER WEED FABRIC ALTERNATE: CONCRETE PAVEMENT
	CONCRETE PAVEMENT

- GENERAL NOTES**
- FIELD VERIFY DIMENSIONS & CONDITIONS PRIOR TO START OF CONSTRUCTION. NOTIFY ARCHITECT IMMEDIATELY OF ANY DISCREPANCY OR SITUATION DISCOVERED THAT DOES NOT CONFORM TO CONSTRUCTION DOCUMENTS.
 - WORK PERFORMED IS SUBJECT TO APPROVAL BY THE ARCHITECT AND OWNER. WORK FOUND TO BE UNSATISFACTORY SHALL BE REMOVED AND PROPERLY REPLACED BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER.
 - TEMPORARILY SUPPORT WALLS, HEADERS, STRUCTURES, PIPING, DUCTWORK, CONDUIT, ETC., AS REQUIRED UNTIL FINAL SUPPORTS ARE IN PLACE.
 - PATCH & REPAIR ALL AREAS, SURFACES & MATERIALS TO CONDITION OF SURROUNDING AREA.
 - CLOSELY COORDINATE WORK WITH THE OWNER AND WITH ALL OTHER CONTRACTORS HIRED BY THE OWNER. CLARIFY IN ADVANCE ANY QUESTIONS AS TO SCOPE OF WORK AND AREAS OF RESPONSIBILITY.
 - PATCH AND REPAIR DISTURBED LAWN AREAS.
 - DIMENSIONS ARE TO FACE OF CURB, FENCE, COLUMN OR CENTERLINE UNLESS OTHERWISE NOTED. WALLS SHALL BE CENTERED ON DOORWAYS.
 - WALKS SHALL MEET BOTH VERTICALLY AND HORIZONTALLY.
 - LAYOUT AND DIMENSIONS ARE PARALLEL AND PERPENDICULAR TO ONE ANOTHER UNLESS OTHERWISE INDICATED IN PLANS.
 - CONTRACTOR SHALL CALL OUPRS (800) 362-2764 PRIOR TO COMMENCEMENT OF ANY WORK.








NEW BUILDING AND RENOVATIONS FOR
VAN WERT CITY SCHOOLS
EGGERS STADIUM - PHASE FOUR
305 WEST CRAWFORD STREET - VAN WERT, OHIO 43081

ISSUANCES/REVISIONS	
CONSTRUCTION DOCUMENTS	01/29/2026
1 ADDENDUM 02	02/20/2026

PROJECT NUMBER: 25089.00	DRAWN BY: CPD	CHECKED BY: MAD
------------------------------------	------------------	--------------------

SHEET TITLE:
SITE LAYOUT AND MATERIALS PLAN

SHEET NUMBER:
L1.1

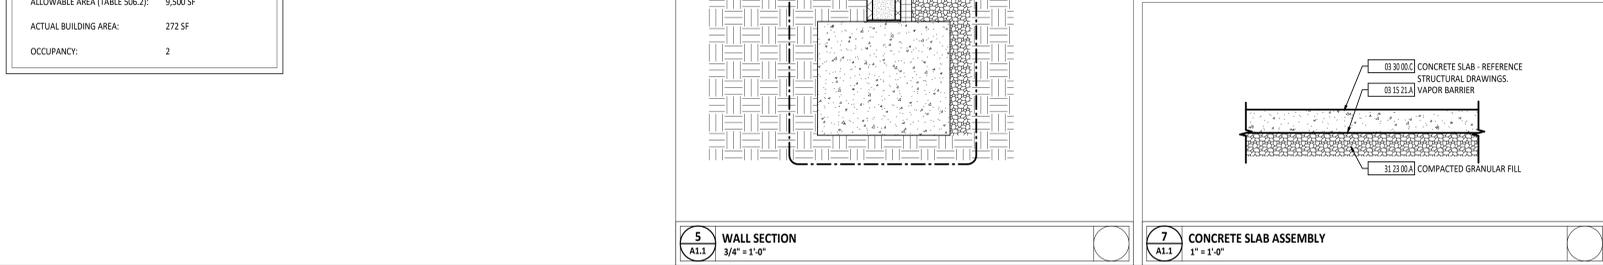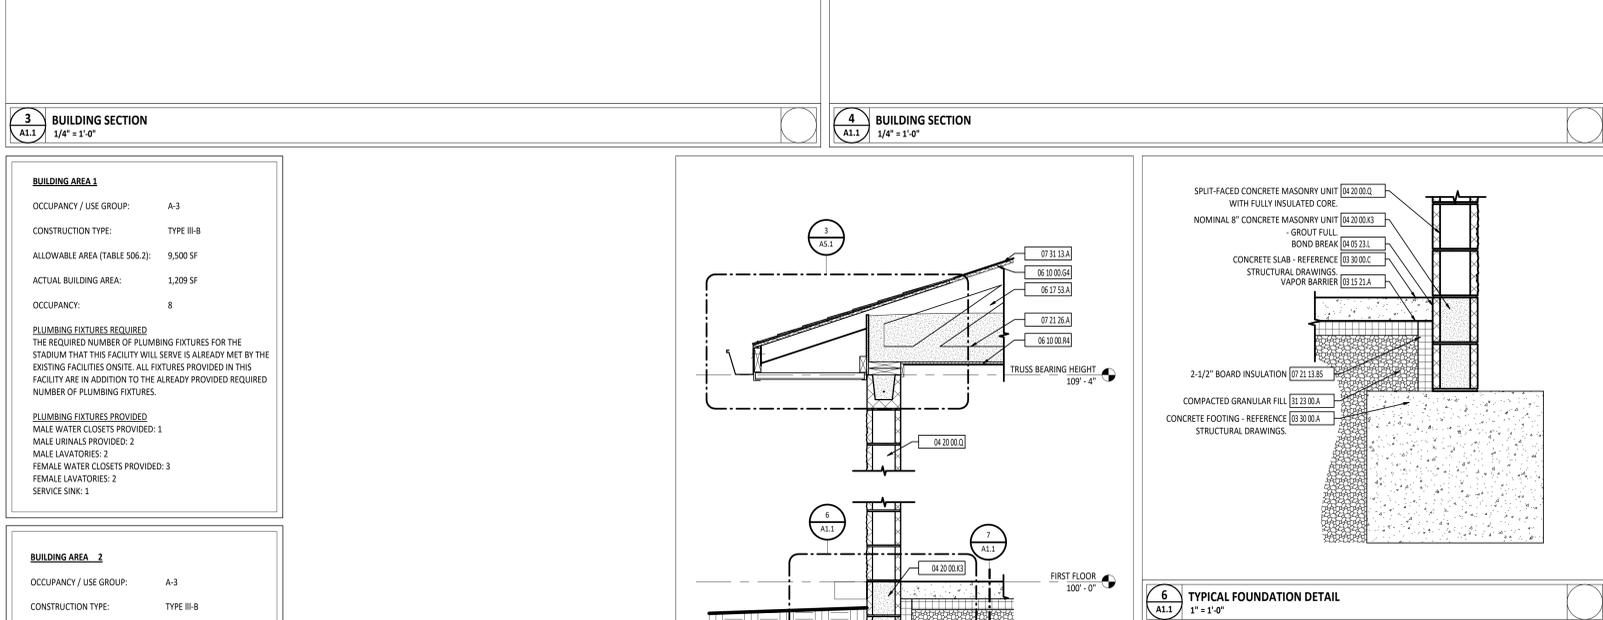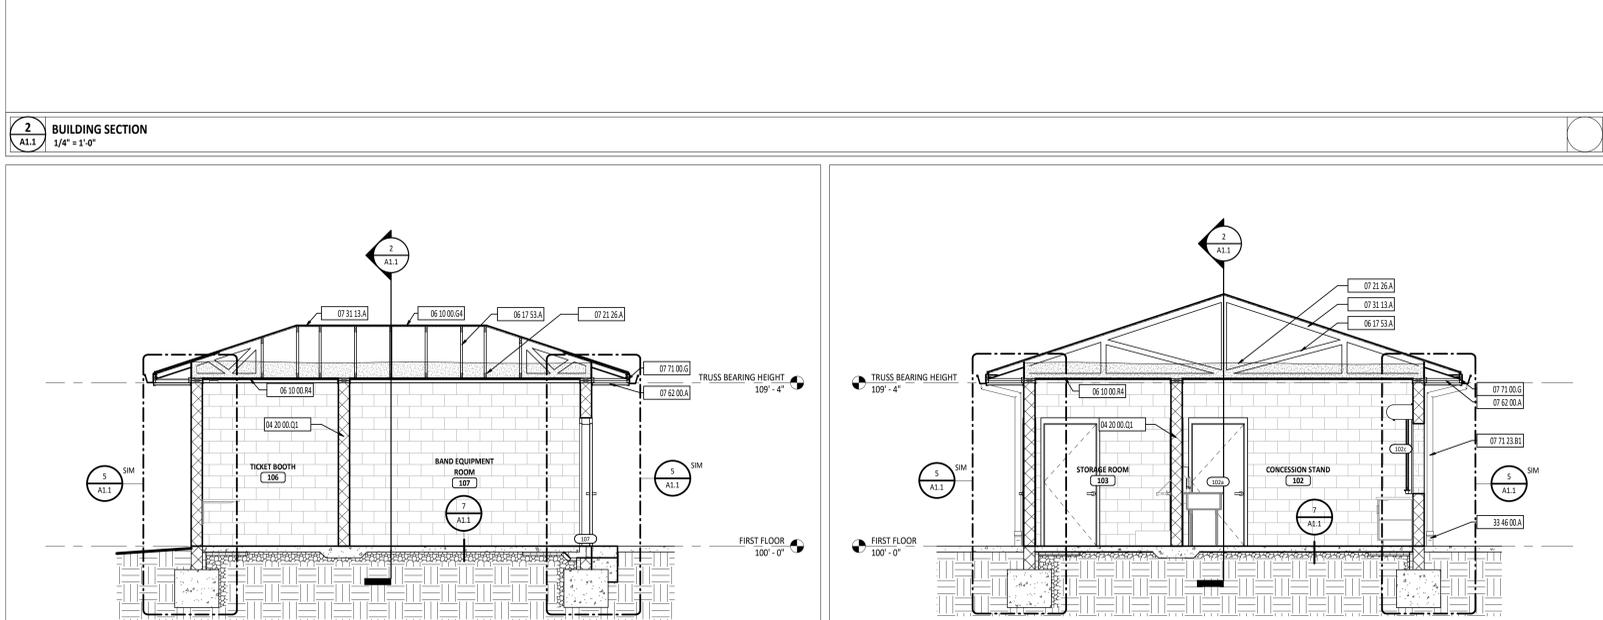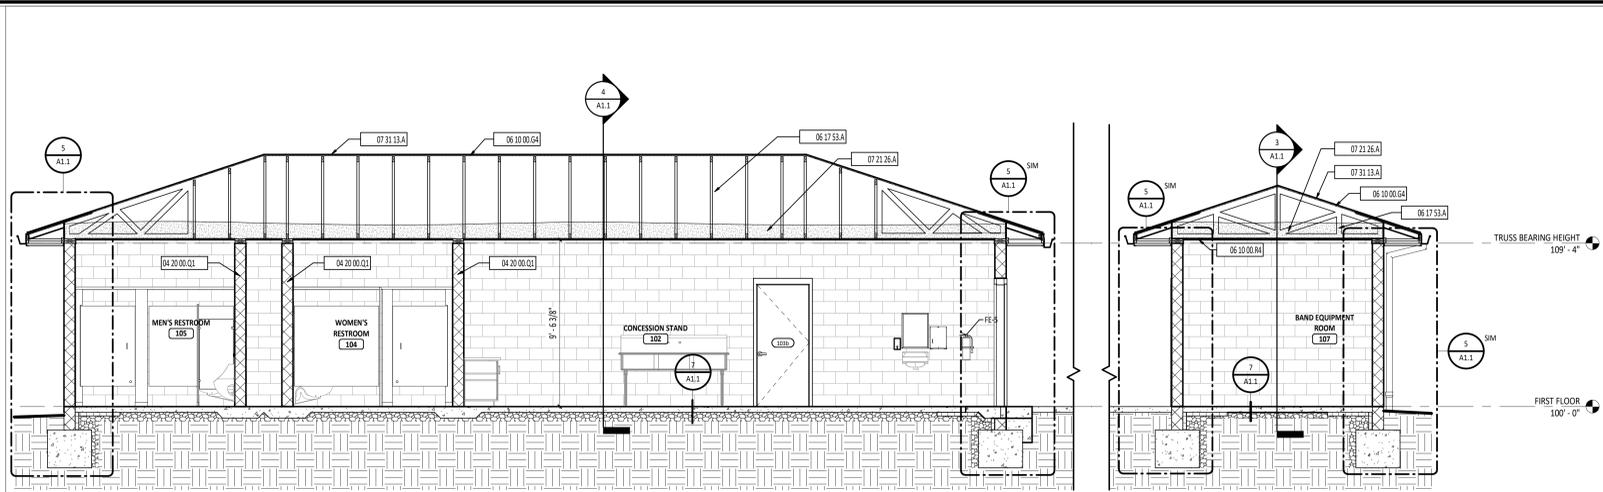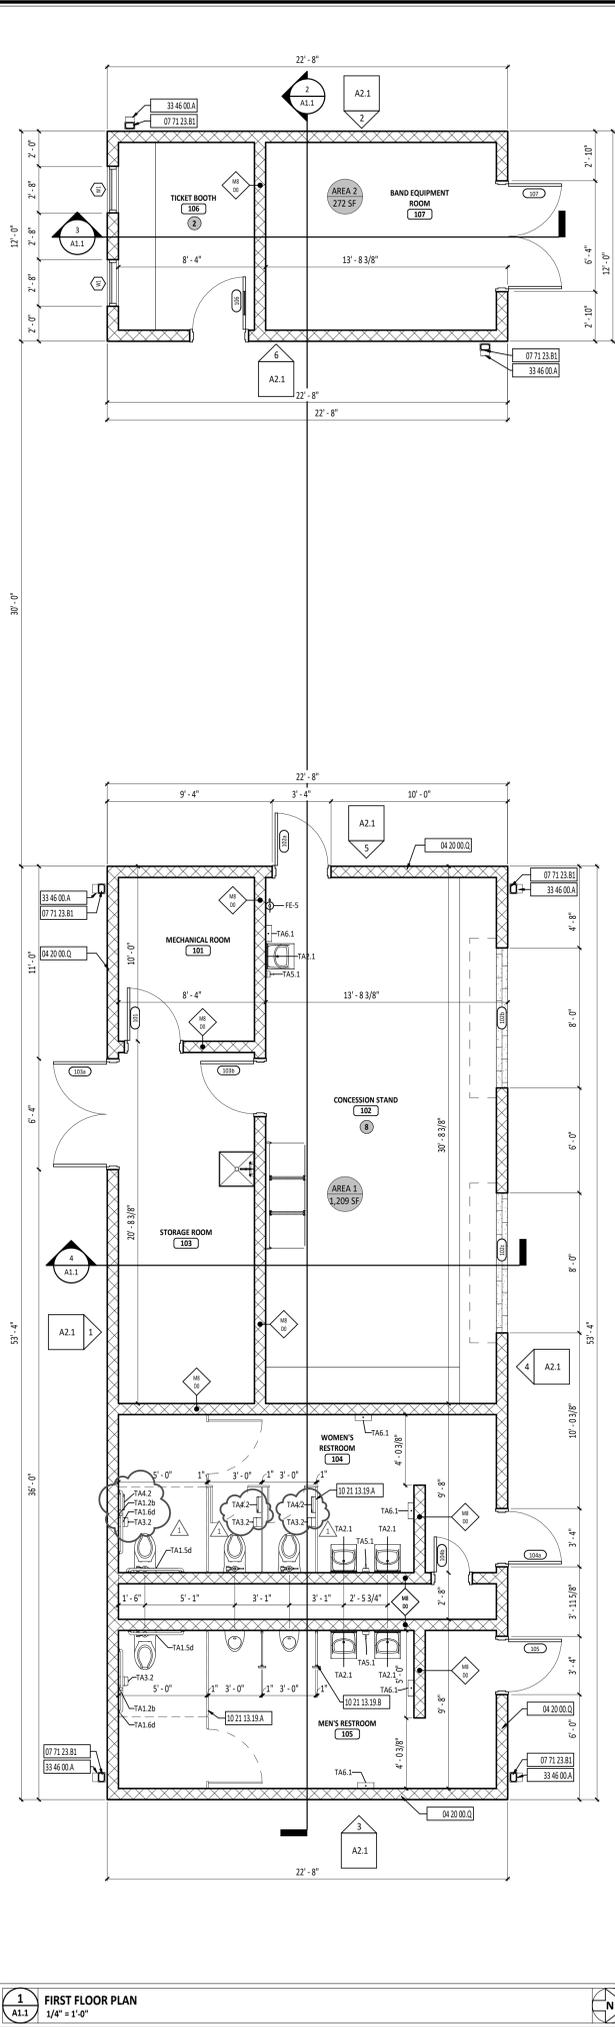

FIRST FLOOR PLAN ROOM INDEX - OVERALL			
ROOM NUMBER	ROOM NAME	AREA	OCCUPANCY
101	MECHANICAL ROOM	72 SF	
102	CONCESSION STAND	393 SF	8
103	STORAGE ROOM	154 SF	
104	WOMEN'S RESTROOM	190 SF	
105	MEN'S RESTROOM	190 SF	
106	TICKET BOOTH	83 SF	2
107	BAND EQUIPMENT ROOM	140 SF	

TOILET ACCESSORY SCHEDULE		
MARK	DESCRIPTION	NOTES
TA1.2b	GRAB BAR - SURFACE MOUNT - VERTICAL - 18" LENGTH - 39" AFF TO BOTTOM OF THE BAR	
TA1.5d	GRAB BAR - SURFACE MOUNT - HORIZONTAL - 36" LENGTH - 36" AFF TO TOP OF THE GRIPPING SURFACE	
TA1.6d	GRAB BAR - SURFACE MOUNT - HORIZONTAL - 42" LENGTH - 36" AFF TO TOP OF THE GRIPPING SURFACE	
TA2.1	MIRROR - SURFACE MOUNT - 18" X 36" - 40" AFF TO BOTTOM EDGE	
TA3.2	TOILET PAPER DISPENSER - SURFACE MOUNT - 18" AFF TO BOTTOM	
TA4.2	SANITARY NAPKIN DISPOSAL - SURFACE MOUNT - 30" AFF TO TOP	
TA5.1	SOAP DISPENSER - SURFACE MOUNT - 40" AFF TO OPERATION	
TA6.1	PAPER TOWEL DISPENSER UNIT - SURFACE MOUNT - FOLDED TOWELS - 40" AFF TO OPERATION	

#	KEYNOTE DESCRIPTION
03 15 21.A	VAPOR BARRIER
03 30 00.A	CONCRETE FOOTING - REFERENCE STRUCTURAL DRAWINGS.
03 30 00.C	CONCRETE SLAB - REFERENCE STRUCTURAL DRAWINGS.
04 05 23.L	BOND BREAK
04 20 00.K3	NOMINAL 8" CONCRETE MASONRY UNIT - GROUT FULL.
04 20 00.Q	SPLIT-FACED CONCRETE MASONRY UNIT WITH FULLY INSULATED CORE.
04 20 00.Q1	NOMINAL 4" X 8" X 16" SPLIT-FACED CONCRETE MASONRY UNIT
06 10 00.G4	5/8" PLYWOOD
06 10 00.R4	T1-11 SHEATHING, PAINTED PT2.
06 17 53.A	SHOP-FABRICATED WOOD TRUSS - REFERENCE STRUCTURAL DRAWINGS.
07 21 13.B5	2-1/2" BOARD INSULATION
07 21 26.A	R-49 BLOWN INSULATION
07 31 13.A	ASPHALT SHINGLE ROOFING
07 62 00.A	PREFINISHED METAL SOFFIT SYSTEM ATTACHED TO THE UNDERSIDE OF THE ROOF JOIST.
07 71 00.G	PREFINISHED ALUMINUM FASCIA
07 71 23.B1	4" X 6" PREFINISHED METAL DOWNSPOUT
10 21 13.19.A	PLASTIC TOILET COMPARTMENT
10 21 13.19.B	PLASTIC URINAL SCREEN
31 23 00.A	COMPACTED GRANULAR FILL
33 46 00.A	PVC DOWNSPOUT BOOT - BY SITE CONTRACTOR

FLOOR PLAN SYMBOLS LEGEND			
AE-D	AUTOMATED EXTERNAL DEFIBRILLATOR DESIGNATION		
DOOR	DOOR DESIGNATION - REFERENCE DOOR/OPENING SCHEDULE.		
FE- <u> </u>	FIRE EXTINGUISHER DESIGNATION - REFERENCE SPECIFICATIONS		
FE-C- <u> </u>	FIRE EXTINGUISHER CABINET DESIGNATION - REFERENCE SPECIFICATIONS		
ROOM	ROOM DESIGNATION - REFERENCE ROOM INDEX.		
CURTAIN WALL/STOREFRONT/WINDOW	CURTAIN WALL/STOREFRONT/WINDOW TYPE DESIGNATION		
WALL TYPE	WALL TYPE DESIGNATION - REFERENCE WALL TYPES.		
STRUCTURAL GRID	STRUCTURAL GRID - REFERENCE STRUCTURAL DRAWINGS.		
KEYNOTE	DIVISIONAL KEYNOTE DESIGNATION - REFERENCE KEYNOTE SCHEDULE AND SPECIFICATIONS FOR ADDITIONAL INFORMATION.		
CALLOUT	CALLOUT - DETAIL NUMBER - SHEET NUMBER		
EXTERIOR ELEVATION	EXTERIOR ELEVATION - DETAIL NUMBER - SHEET NUMBER		
INTERIOR ELEVATION	INTERIOR ELEVATION - DETAIL NUMBER - SHEET NUMBER		
SECTION	SECTION - DETAIL NUMBER - SHEET NUMBER		

CODE PLAN LEGEND	
⊗	OCCUPANT LOAD THROUGH EXIST

OCCUPANCY GROUPS USED	
ASSEMBLY	NEW AREA
RENOVATED AREA	EXISTING AREA

FLOOR PLAN GENERAL NOTES		
A	ALL DIMENSIONS ARE MEASURED TO THE FACE OF MASONRY OR THE FACE OF WOOD STUD UNLESS NOTED OTHERWISE.	
B	ALL CMI CORNERS, HORIZONTAL OR VERTICAL, SHALL BE BULLNOSE UNLESS NOTED OR DETAILED OTHERWISE.	
C	INSTALL TREATED WOOD BLOCKING IN WALLS AS REQUIRED TO SECURE ALL EQUIPMENT, ACCESSORIES, HANDRAILS, CASEWORK, ETC. COORDINATE THIS WORK WITH ALL APPROPRIATE CONTRACTORS, SUPPLIERS AND MANUFACTURERS RECOMMENDATIONS.	
F	HINGE SIDE OF DOOR JAMB AT INTERSECTING WALLS TO BE LOCATED 4" FROM ADJACENT WALL UNLESS NOTED OTHERWISE - REFERENCE FLOOR PLANS.	
G	IF WALL TYPE IS NOT IDENTIFIED, WALL IS TO RUN FULL HEIGHT TO DECK.	

FIRE EXTINGUISHER / CABINET SCHEDULE		
MARK	DESCRIPTION	NOTES
FE-5	FIRE EXTINGUISHER - 5.0LB - CLASS A-B-C	FURNISHED AND INSTALLED BY GC
FE-C-5	SEMI-RECESSED FIRE EXTINGUISHER CABINET	FURNISHED AND INSTALLED BY GC

ISSUANCES/REVISIONS			
CONSTRUCTION DOCUMENTS	DATE	BY	REASON
1	02/20/2025		ISSUANCE
2	02/20/2025		REVISION

PROJECT NUMBER:	DRAWN BY:	CHECKED BY:
25089.00	BER	RJH

SHEET TITLE:	
FLOOR PLAN, BUILDING SECTIONS, AND WALL SECTIONS/DETAILS	







SHEET NUMBER:	
A1.1	



VAN WERT CITY SCHOOLS
EGGERS STADIUM-PHASE FOUR

FEEDER SCHEDULE

MARK	NO. OF SETS	CONDUCTOR SIZING				CONDUIT SIZE EACH SET	Comments
		QTY	PHASE	NEUTRAL SIZE	GROUND SIZE EACH SET		
70	1	3	#4 AWG CU		#8 AWG CU	1"	
100	1	3	#1 AWG CU		#8 AWG CU	1 1/4"	
150N	1	3	#1/0 AWG CU	1	#1/0 AWG CU	1 1/2"	
400N	1	3	#600 MCM	1	#600 MCM	N/A	
ETR						0"	EXISTING TO REMAIN

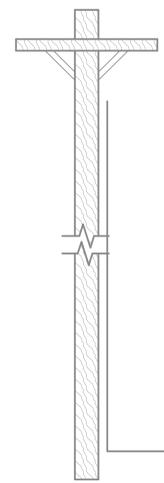

NOTE: ALL ELECTRICAL EQUIPMENT AND FEEDS SHOWN FADED ARE EXISTING UNO.

1 NEW ELECTRICAL ONE-LINE DIAGRAM

DISTRIBUTION PANEL MDP (EXISTING)

MOUNTING: SURFACE
FED FROM: UTILITY ENCLOSURE: TYPE 3R
LOCATION: (EXISTING)
AIC RATING: EXISTING
VOLTAGE: 480Y/277V 3PH 4W
MAINS RATING: 400 A
MAINS TYPE: 400 A | MCB
OTHER:

PANEL NOTES: ALL BREAKERS/CIRCUITS ARE EXISTING UNO.

NO. OF SETS	PHASE	QTY	SIZE	NEUTRAL SIZE	GROUND SIZE EACH SET	CONDUIT SIZE EACH SET	Comments
1	T2	3	100 A	3	14300 / 36267	2	FL
3	SPARE BREAKER	100 A	9	0 / 34142	1175 A	3	XFMR-T1
1	SPACE ONLY	1	13	0 / 0	14	1	SPACE ONLY
1	SPACE ONLY	1	15	0 / 0	16	1	SPACE ONLY
1	SPACE ONLY	1	17	0 / 0	18	1	SPACE ONLY
1	SPACE ONLY	1	19	0 / 0	20	1	SPACE ONLY
1	SPACE ONLY	1	21	0 / 0	22	1	SPACE ONLY
1	SPACE ONLY	1	23	0 / 0	24	1	SPACE ONLY

VA SUBTOTALS: 85004 VA
AMP SUBTOTALS: 311 A

LOAD TYPE	CONNECTED VA	DEMAND FACTOR	DEMAND VA	DEMAND AMPS	SUBTOTAL	PHASE	CIRCUIT NOTES:
FIRE ALARM	500 VA	100.0%	500 VA	1 A	85004 VA	A	1-EXISTING SPARE BREAKER, NEW LOAD. SEE ONE-LINE DIAGRAM FOR FEED SIZE.
HVAC	22480 VA	100.0%	22480 VA	27 A	88428 VA	B	
Lighting	83264 VA	100.0%	83264 VA	100 A	76813 VA	C	
Motor	24486 VA	111.3%	27406 VA	33 A			
Other	1500 VA	100.0%	1500 VA	2 A	252244 VA	CONNECTED	
Power	58126 VA	70.0%	40688 VA	49 A	210772 VA	DEMAND	
RECEPTACLE	59890 VA	58.3%	34945 VA	42 A	301 A	CONNECTED	
					252 A	DEMAND	

PANEL C (NEW)

MOUNTING: SURFACE
FED FROM: T2
ENCLOSURE: TYPE 1
LOCATION: MECHANICAL ROOM 101
AIC RATING: 10,000A
VOLTAGE: 208Y/120V 3PH 4W
MAINS RATING: 225 A
MAINS TYPE: 150 A | MCB
OTHER:

PANEL NOTES:

NO. OF SETS	PHASE	QTY	SIZE	NEUTRAL SIZE	GROUND SIZE EACH SET	CONDUIT SIZE EACH SET	Comments
1	T2	2	15 A	2	750 / 180	2	TECH. ROOM C103
1	RECEPTACLE CONCESSION STAND	102	20 A	29	1500 / 180	30	RECEPTACLE CONCESSION STAND 102
1	RECEPTACLE CONCESSION STAND	102	20 A	31	1500 / 180	32	RECEPTACLE CONCESSION STAND 102
1	RESTROOM RECEPTABLES	1	20 A	33	540 / 1220	34	RESTROOM RECEPTABLES
1	RH-1 CONCESSION STAND C102	2	15 A	37	900 / 900	38	RH-1 CONCESSION STAND C102
1	RH-3 CONCESSION STAND C102	2	15 A	41	900 / 900	42	RH-3 CONCESSION STAND C102
1	RH-5 STORAGE C105	2	15 A	43	900 / 750	44	RH-5 STORAGE C105
1	RH-7 WOMEN'S RR C104	2	20 A	47	750 / 900	48	RH-7 WOMEN'S RR C104
1	RH-9 MEN'S RESTROOM 105	2	15 A	51	900 / 1262	52	RH-9 MEN'S RESTROOM 105
1	SPARE BREAKER	1	20 A	55	0 / 869	56	SPARE BREAKER
1	SPARE BREAKER	1	20 A	57	0 / 0	58	SPARE BREAKER
1	SPARE BREAKER	1	20 A	59	0 / 0	60	SPARE BREAKER

VA SUBTOTALS: 14600 VA
AMP SUBTOTALS: 123 A

LOAD TYPE	CONNECTED VA	DEMAND FACTOR	DEMAND VA	DEMAND AMPS	SUBTOTAL	PHASE	CIRCUIT NOTES:
Lighting	931 VA	100.0%	931 VA	3 A	14600 VA	A	1 = #212 AWG CU, #12 AWG CU GND, 3/4"
Motor	960 VA	112.5%	1080 VA	3 A	14393 VA	B	2 = 1-1/4"
Other	0 VA	0.0%	0 VA	0 A	13315 VA	C	3 = SEE ONE-LINE DIAGRAM
Power	23000 VA	70.0%	16100 VA	46 A			4 = #210 AWG XHHW CU, #110 AWG XHHW CU GND.
RECEPTACLE	17460 VA	78.6%	13730 VA	38 A	42306 VA	CONNECTED	
					31790 VA	DEMAND	
					117 A	CONNECTED	
					88 A	DEMAND	

LUMINAIRE SCHEDULE

MARK	MOUNTING	TYPE	MIN. LUMENS	CCT	CRI	BALLAST/DRIVER	FIXTURE VOLTAGE	INPUT WATTS	FIXTURE DESCRIPTION	COMMENTS	BASIS OF DESIGN & APPROVED MANUFACTURERS
B1	SURFACE	LED	2400 lm	4000K	80 CRI	0-10V DIMMING DOWN TO 10%	UNV	18 W	1' X 4' LED PANEL, SURFACE MOUNT KIT, 0-10V 10% DIMMING DRIVER, EXTRUDED ALUMINUM FRAME, SATIN WHITE LENS	SET AT LOW LUMENS AND 4000K CCT	LITHONIA CPX 1X4 A07 80CRI SWW7 5WL MVOLT 1X4SMKSH DAYBRITE SBP SERIES COLUMBIA CBT SERIES METALUX CGTS SERIES
B2	SURFACE	LED	3300 lm	4000K	80 CRI	0-10V DIMMING DOWN TO 10%	UNV	24 W	1' X 4' LED PANEL, SURFACE MOUNT KIT, 0-10V 10% DIMMING DRIVER, EXTRUDED ALUMINUM FRAME, SATIN WHITE LENS	SET AT MED LUMENS AND 4000K CCT	LITHONIA CPX 1X4 A07 80CRI SWW7 5WL MVOLT 1X4SMKSH DAYBRITE SBP SERIES COLUMBIA CBT SERIES METALUX CGTS SERIES
C1	PENDANT	LED	4000 lm	4000K	80 CRI	0-10V DIMMING DOWN TO 10%	UNV	35 W	4' LED STRIP, LOW-GLARE DIFFUSE LENS, HIGH-GLOSS, BAKED WHITE ENAMEL FINISH	HANG AT 8'-0" (MIN.) AFF.	LITHONIA CSS L48 4000LM MVOLT 40K 80CRI DAYBRITE FSS SERIES COLUMBIA CSL SERIES METALUX SLSTP SERIES
C2	WALL	LED	8000 lm	4000K	80 CRI	0-10V DIMMING DOWN TO 10%	UNV	72 W	8' LED STRIP, LOW-GLARE DIFFUSE LENS, HIGH-GLOSS, BAKED WHITE ENAMEL FINISH	HANG AT 8'-0" (MIN.) AFF.	LITHONIA CSS L86 8000LM MVOLT 40K 80CRI DAYBRITE CSL SERIES COLUMBIA CSL SERIES METALUX SLSTP SERIES
EM	WALL	LED	N/A	N/A	N/A	ELECTRONIC BALLAST	UNV	1 W	EMERGENCY LIGHT (90 MIN. BATTERY), FLAME RETARDANT, HIGH-IMPACT, THERMOPLASTIC HOUSING, ADJUSTABLE LAMPS	WALL MOUNT AT 8'-0" AFF. PROVIDE WIRE GUARD WHERE NOTED ON DRAWINGS.	LITHONIA EL2C DISTRIBUTION ECOM SERIES COMPASS CU2 SERIES SURE-LITES APEL
F1	WALL STEM	LED	1200 lm	4000K	80 CRI	INTEGRAL	UNV	12 W	WALL STRAIGHT STEM MOUNTED LED FIXTURE, SINGLE HEAD, 40 DEGREE FLOOD LIGHT, TEXTURE DARK BRONZE FINISH	PROVIDE WITH STRAIGHT STEM, 12" LONG, WITH FIXTURE ON TOP OF STEM, BASIS OF DESIGN HYDRE S12	LITHONIA PLACER LED A P1 80CRI 40K 120V 40DEG FLC WMC S12 CZ BR7 VISION 3 LIGHTING S12A SERIES SPECTRUM LIGHTING XT SERIES
S1	WALL/SURFACE	LED	1000 lm	4000K	80 CRI	INTEGRAL	UNV	15 W	LED WALL SCORCE, DOWN LIGHT ONLY, ALUMINUM HOUSING, DARK BRONZE POWDER COAT FINISH, WET LOCATION LISTED		REGA LIGHTING S24374 K4 BR2 LITON WD1473 SERIES LIGHTWAY TXW-LED SERIES BROWNLEE BRICK-00 SERIES
W2	WALL	LED	3200 lm	4000K	80 CRI	ELECTRONIC BALLAST	UNV	23 W	LED WALL PACK, DIE-CAST ALUMINUM HOUSING, DARK BRONZE POWDER COAT FINISH, WIDE DISTRIBUTION	MOUNT FIXTURE AT 8'-0" AFF.	LITHONIA WGE2 LED P3 40K 80CRI VW MVOLT PE DDBXD GARDCO GWM SERIES SPECTRUM LIGHTING XT SERIES LUMARK AXCS SERIES
W2E	WALL	LED	3200 lm	4000K	80 CRI	ELECTRONIC BALLAST	UNV	23 W	LED WALL PACK, DIE-CAST ALUMINUM HOUSING, DARK BRONZE POWDER COAT FINISH, WIDE DISTRIBUTION, EMERGENCY BATTERY.	MOUNT FIXTURE AT 8'-0" AFF.	LITHONIA WGE2 LED P3 40K 80CRI VW MVOLT PE EAWH DDBXD GARDCO GWM SERIES SPECTRUM LIGHTING RWLL SERIES LUMARK AXCS SERIES

PANEL D (NEW)


MOUNTING: SURFACE
FED FROM: C
ENCLOSURE: TYPE 1
LOCATION: TICKET BOOTH 106
AIC RATING: 10,000A
VOLTAGE: 208Y/120V 3PH 4W
MAINS RATING: 100 A
MAINS TYPE: 50 A | MCB
OTHER:

PANEL NOTES:

NO. OF SETS	PHASE	QTY	SIZE	NEUTRAL SIZE	GROUND SIZE EACH SET	CONDUIT SIZE EACH SET	Comments
1	T2	1	20 A	1	127 / 540	2	LIGHTING BAND STORAGE
1	RECEPTACLE CONCESSION STAND	1	20 A	3	720 / 600	4	RECEPTACLE CONCESSION STAND 102
1	EXTERIOR LIGHTING	1	20 A	5	73 / 600	6	EXTERIOR LIGHTING
1	SPARE BREAKER	1	20 A	7	0 / 600	8	SPARE BREAKER
1	SPARE BREAKER	1	20 A	9	0 / 600	10	SPARE BREAKER
1	SPARE BREAKER	1	20 A	11	0 / 0	12	SPARE BREAKER
1	SPACE ONLY	1	13	0 / 0	14	20 A	SPARE BREAKER
1	SPACE ONLY	1	15	0 / 0	16	20 A	SPARE BREAKER
1	SPACE ONLY	1	17	0 / 0	18	1	SPACE ONLY
1	SPACE ONLY	1	19	0 / 0	20	1	SPACE ONLY
1	SPACE ONLY	1	21	0 / 0	22	1	SPACE ONLY
1	SPACE ONLY	1	23	0 / 0	24	1	SPACE ONLY

VA SUBTOTALS: 1262 VA
AMP SUBTOTALS: 11 A

LOAD TYPE	CONNECTED VA	DEMAND FACTOR	DEMAND VA	DEMAND AMPS	SUBTOTAL	PHASE	CIRCUIT NOTES:
Lighting	200 VA	100.0%	200 VA	1 A	1262 VA	A	
Power	2400 VA	70.0%	1680 VA	5 A	1920 VA	B	
RECEPTACLE	1260 VA	100.0%	1260 VA	3 A	669 VA	C	
					3851 VA	CONNECTED	
					3131 VA	DEMAND	
					11 A	CONNECTED	
					9 A	DEMAND	



VAN WERT CITY SCHOOLS EGGERS STADIUM-PHASE FOUR

ISSUANCES/REVISIONS

NO.	DESCRIPTION	DATE
1	CONSTRUCTION DOCUMENTS	01/29/2025
2	ADDENDUM 02	02/20/2025

PROJECT NUMBER: 25089.00

DRAWN BY: HJP

CHECKED BY: KCR

ONE-LINE DRAWING, PANEL AND LUMINAIRE SCHEDULES